

# **ADL400**



## General

ADL400 three phase electric meter is designed for three phase energy measurement on low voltage system. The meter meet the related technical requirements of electronic meter in the IEC62053-21 IEC62053-22 standards.

#### **Functions**

F+#	December 1	Descride
Function	Description	Provide
Measurement of kWh	kWh (positive and negative)	•
	kvarh (positive and negative)	•
	A, B, C phase positive kWh	•
Measurement of electrical parameters	U、IP、Q、S、PF、Hz	•
Measurement of harmonics	2~31ST harmonic	•
LCD Display	12 digits	•
Key programming	3 keys	
Pulse output	kWh	
Data	Maximum demanded	
	Frozen data on last 48 months,	П
	last 90days	
	Date, time	
Communication	Infrared	•
	RS485, MODBUS-RTU	

Note:(■: means standard, □:means optional)

### **Parameters**

### ■ Electric performance

	Nominal voltage	3×100V、3×380V、
Voltage		3×57.7/100V、3×220/380V
	Consumption	<10VA(Single phase)
	Impedance	>2ΜΩ
	Accuracy	±0.2%

Maximum current	80A, 6A
Consumption	<1VA
Accuracy	±0.2%
range	45∼65Hz
accuracy	±0.2%
Active energy	Class 0.5s
reactive energy	Class 2
accuracy	≤0.5s/d
Width	80±20ms
constant	1000imp/kWh,10000imp/kWh
Interface	RS485
Protocol	Modbus RTU
	Consumption  Accuracy range accuracy Active energy reactive energy accuracy Width constant Interface

### ■ Working environment

Temperature	Working	-25℃~55℃
	Storing	-40℃~70℃
Humidity	≤95%(No condensation)	
Altitude	<2000m	

# Dimension drawings (Unit: mm)






Figure 1 direct connect

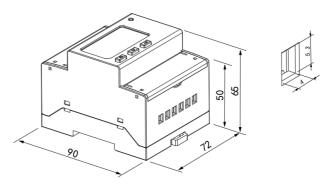


Figure 2 connect via CT

Note: The torque of direct connect should not be greater than  $4.0N\cdot m_{_{\odot}}$  and the torque of connect via CT should not be greater than  $2.0N\cdot m_{_{\odot}}$ 



## Wiring and installing

### Wiring

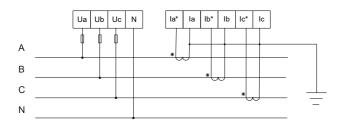


Fig 3 Three phase four lines connect via CT




Fig 4 Three phase four lines direct connect

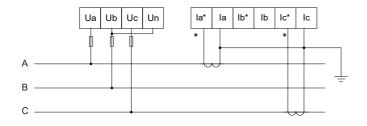


Fig 5 Three phase three lines connect via CT




Fig6 Three phase three lines direct connect




Fig 7 Communication, pulse connection

### Installing



ADL400 installing

Note: DIN 35 mm rail installation.

# Display examples




Total active energy



Voltage of three phase



Current of three phase



power